


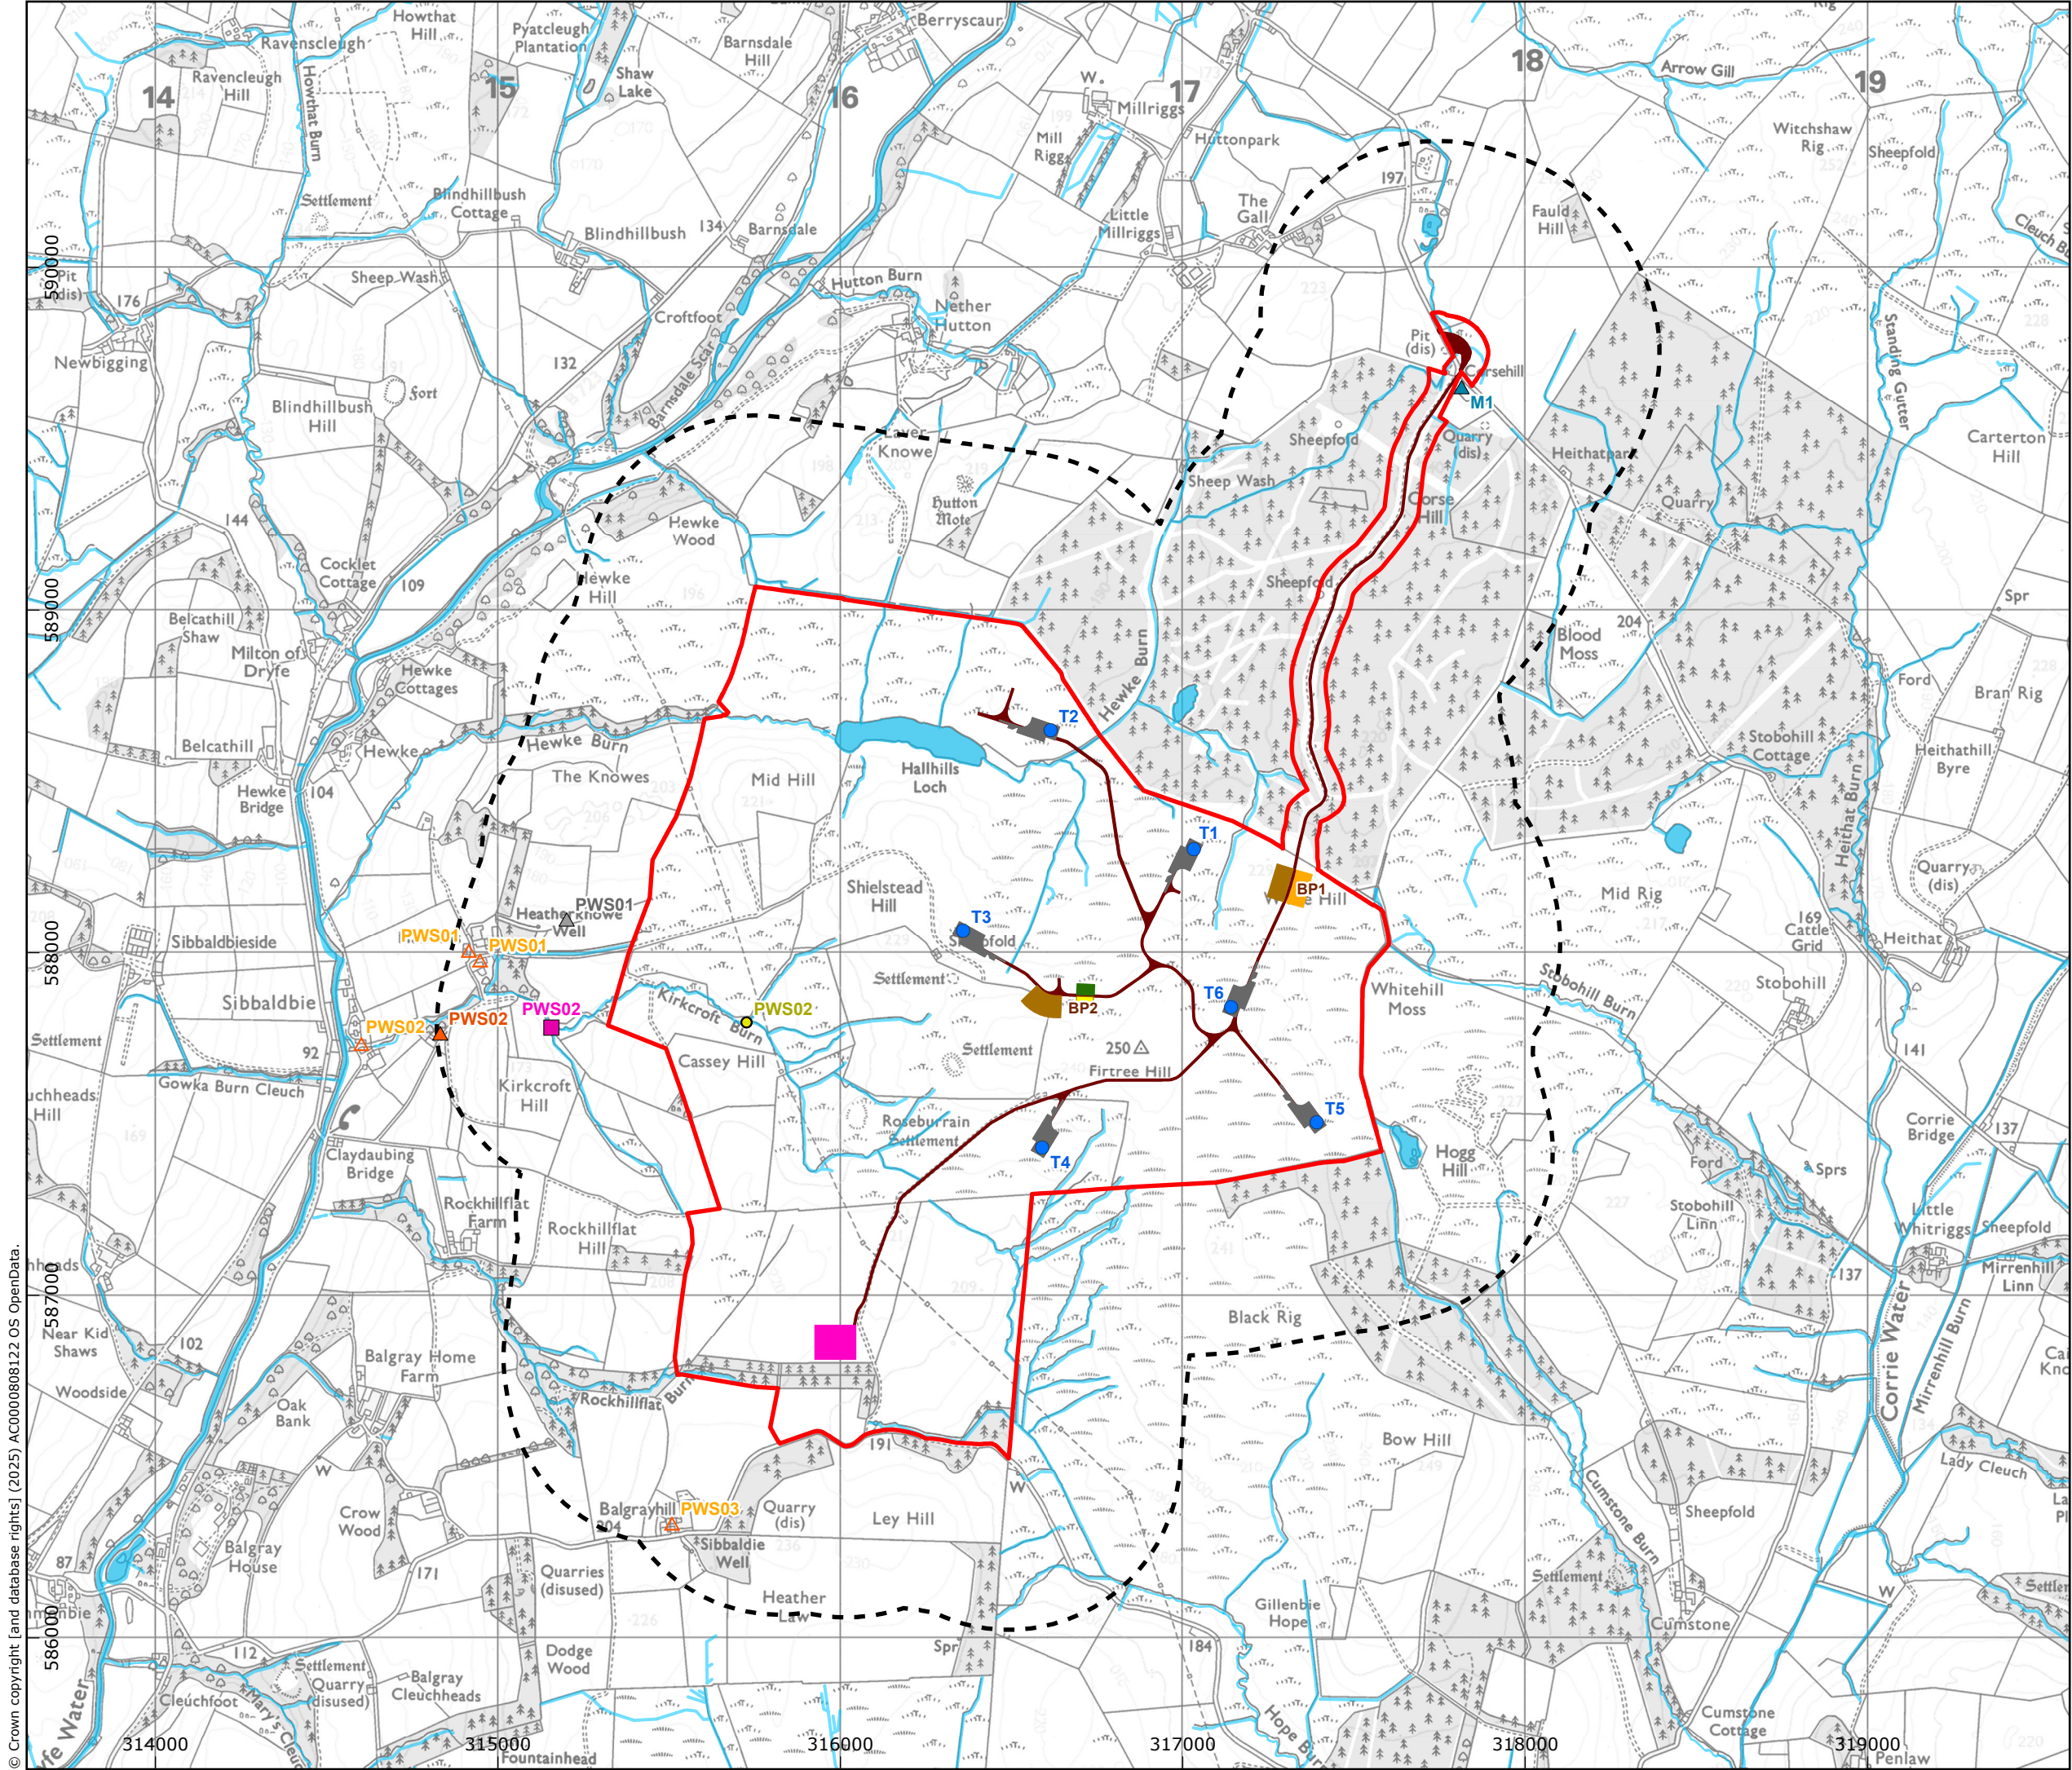

Legend

-  Proposed Site Boundary
-  Study Area (Proposed Site Boundary 500 m Buffer)
-  Proposed Turbine Location
-  Proposed Hardstanding
-  Proposed Substation
-  Proposed Control Room
-  Proposed Battery Energy Storage System (BESS)
-  Proposed Borrow Pit (BP)
-  Proposed Access Track
-  Proposed Temporary Construction Compound (TCC)

Private Water Supply (PWS) Information

-  Property with PWS
-  Property with PWS (unconfirmed)
-  Holding Tank
-  Stream
-  Mains
-  Unknown

0 250 500 Metres

A3 Horizontal Scale 1:18,000

CRS: British National Grid (ESPG:4326)

Produced: MM
Reviewed: JRS
Approved: KR

Date: 11/04/2025	Revision: 0
------------------	-------------

405.065655.00001.0010.0 PWSRA

BELGRAY WIND FARM EIAR

FIGURE 9.3.1 - PRIVATE WATER SUPPLY (PWS) RISK ASSESSMENT

Locogen Consulting Ltd